



EXCEPT AS OTHERWISE PROVIDED BY CONTRACT, THIS DRAWING AND SPECIFICATIONS SHALL NOT BE REPRODUCED, COPIED OR USED AS THE BASIS FOR MANUFACTURE OR SALE OF MATTER DEPICTED HEREIN WITHOUT THE EXPRESSED WRITTEN PERMISSION OF THE CLAUDE LAVAL CORPORATION, OR ITS ASSIGNEES.

THIS DRAWING HAS BEEN GENERATED AND IS MAINTAINED BY A CAD SYSTEM. CHANGES SHALL ONLY BE INCORPORATED AS DIRECTED BY AN APPROVED ENGINEERING CHANGE ORDER (ECO). PAPER COPIES ARE UNCONTROLLED.

REVISIONS				
ECN	REV.	DESCRIPTION	DATE	APPROVED

NOTES:

1. INLET & OUTLET ARE 4" GROOVED PIPE.
2. MAXIMUM PRESSURE: 150 psi (10.3 bar).
3. MAXIMUM TEMPERATURE: 100°F (37.8°C).
4. RATED FLOWRATE: 107-178 gpm (24-40 m³/hr).
5. FILTRATION AREA: 7.2 ft² (0.67 m²).
6. MEDIA SAND REQUIREMENT: 900 lbs (408 kg).
7. SYSTEM WEIGHT (WITHOUT SAND): 638 lbs (289 kg).
8. SYSTEM COMPONENTS SHIPPED LOOSE. FINAL ASSEMBLY BY OTHERS.

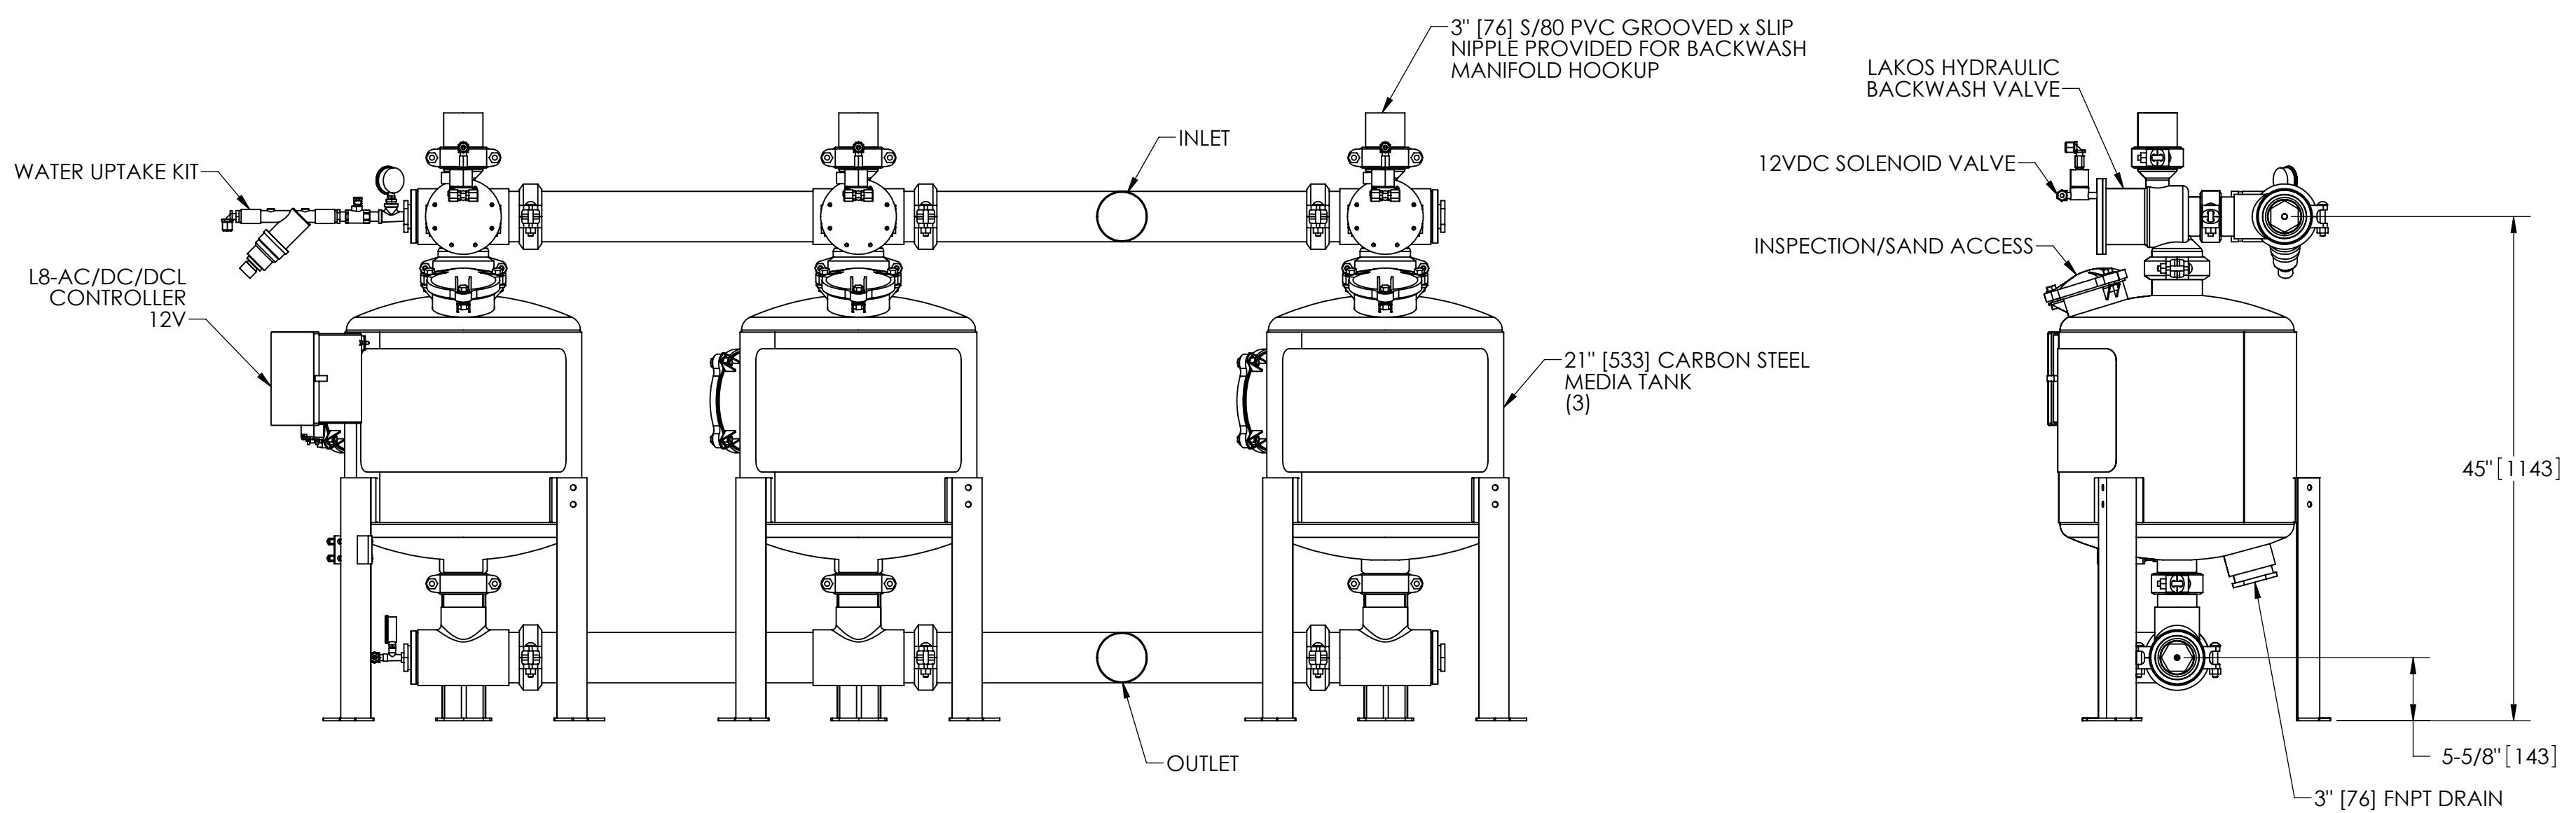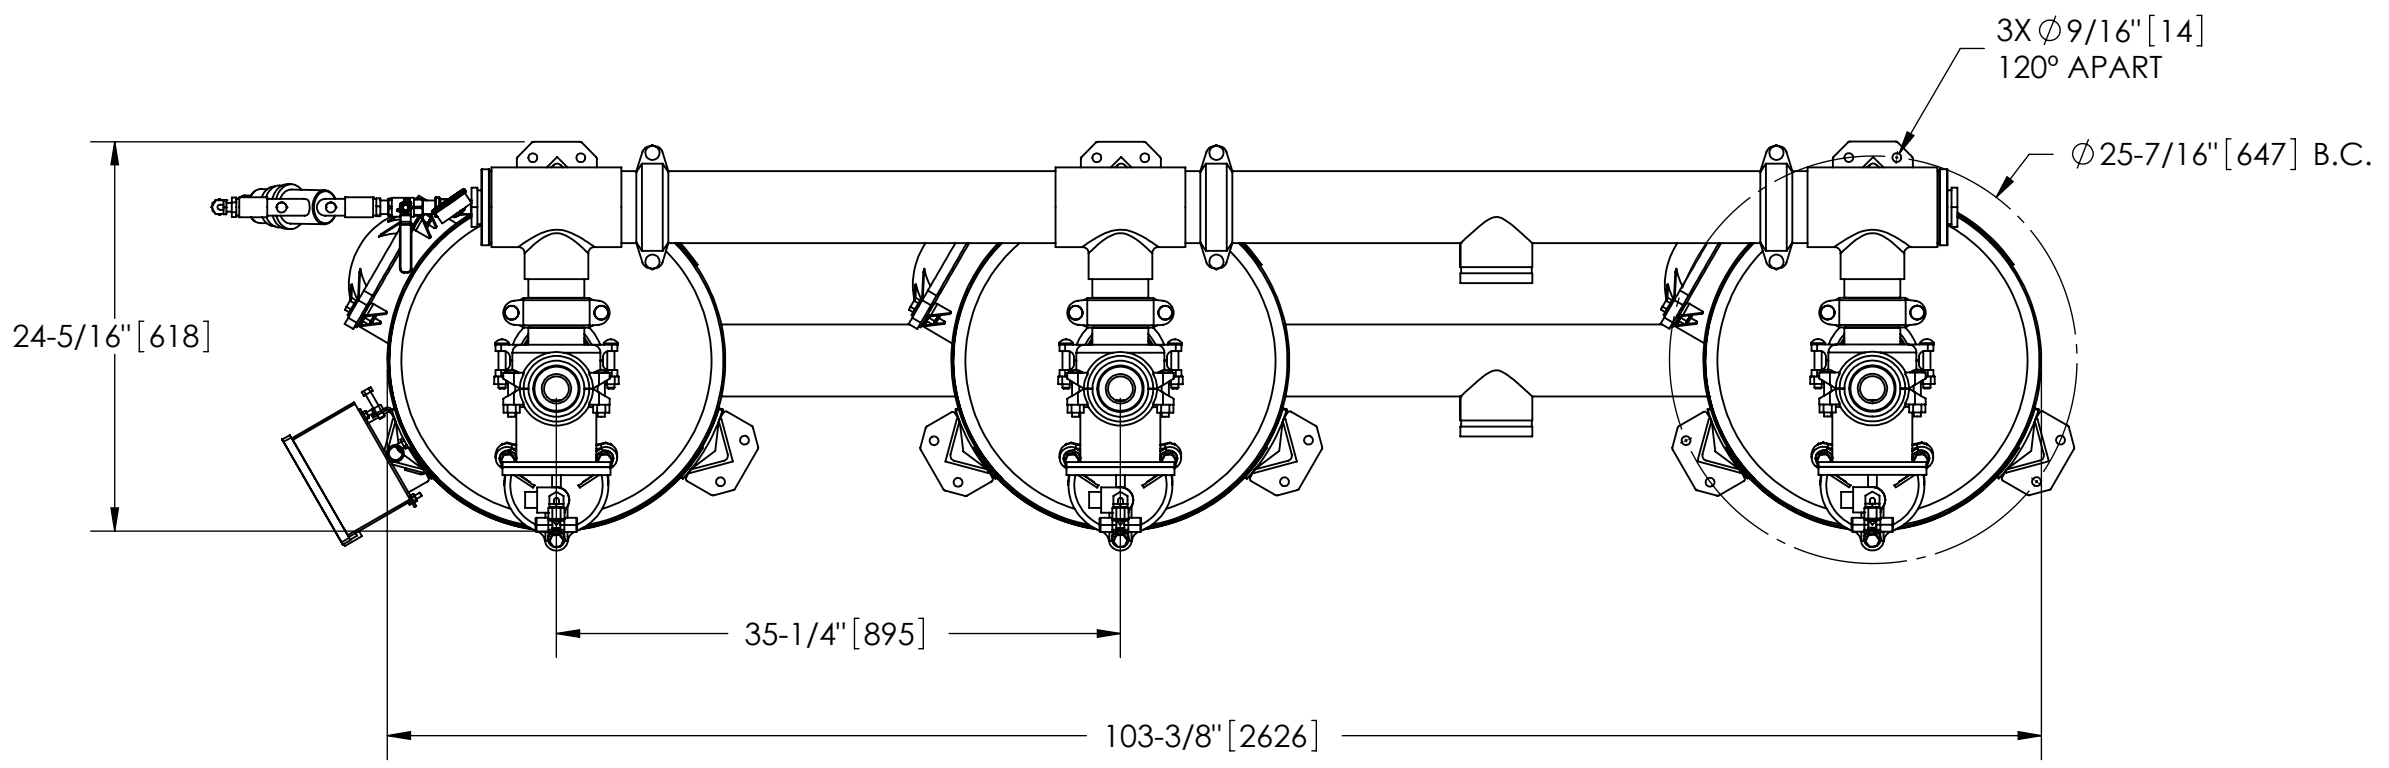

SUBMITTAL DRAWING
 This drawing is submitted for spatial consideration only. Do not pre-plumb to these dimensions.

UNLESS OTHERWISE SPECIFIED: DIMENSIONS ARE IN: INCHES (mm) TOLERANCES ARE: FRACTIONS DECIMALS ANGLES ± 1" .XX ± .01 ± 1/4" .XXX ± .005 .XXXX ± .0005		ENGINEERED FOR: STANDARD		CLAUDE LAVAL CORP. FRESNO, CALIFORNIA 93727 WWW.LAKOS.COM		LAVAL UNDERGROUND SURVEYS	
DO NOT SCALE DRAWING		APPROVALS	DATE	TITLE PROII-2104-3A/C, SYSTEM, 21" 3 TANK MEDIA, AUTO CENTERFEED			
MATERIAL	PER LAKOS SPEC	DRAWN	ENGR	DATE	SIZE	MODEL NO.	DWG NO.
FINISH	AS ASSEMBLED	JBI	-	2/16/11	C	-	PROII-2104-3A/C
		WORK ORDER	QTY.	SCALE	1:12	EST. WT.	638 lb
				SHEET	1 OF 1		

DWG. NO. XXX
 SH. 1
 REV. 01