

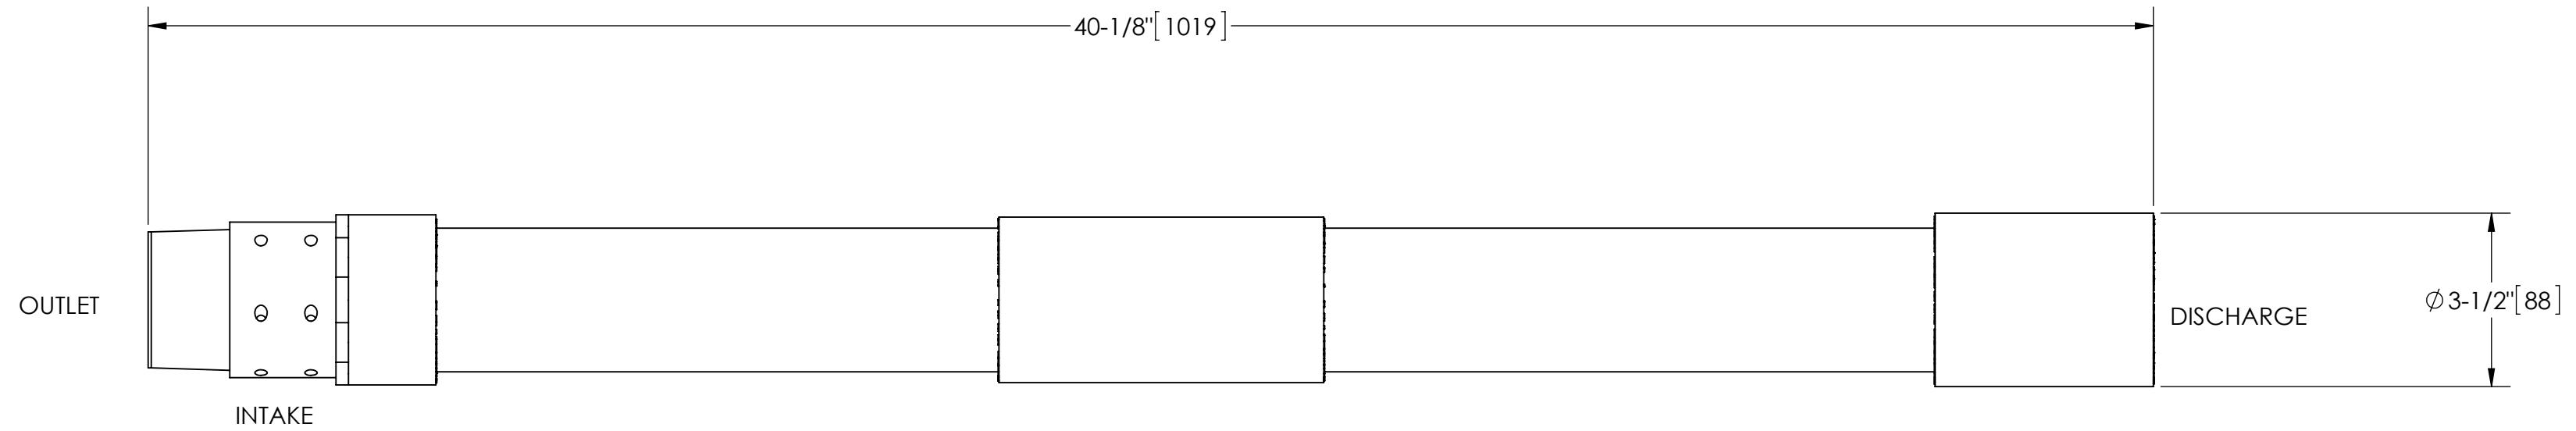
EXCEPT AS OTHERWISE PROVIDED BY CONTRACT, THIS DRAWING AND SPECIFICATIONS SHALL NOT BE REPRODUCED, COPIED OR USED AS THE BASIS FOR MANUFACTURE OR SALE OF MATTER DEPICTED HEREIN WITHOUT THE EXPRESSED WRITTEN PERMISSION OF THE CLAUDE LAVAL CORPORATION, OR ITS ASSIGNEES.

NOTES:

1. OUTLET: 2-1/2" FNPT.
2. RATED FLOW: 14-28 gpm (3-6.5 m³/hr).
3. MINIMUM WELL I.D.: 4" (102 mm).
4. MINIMUM SUBMERGENCE: 30 ft (9.2 m)
5. APPROXIMATE DRY WEIGHT: 4.6 lbs (2.1 kg).
6. IF UNIT IS NOT DIRECTLY CONNECTED TO PUMP INTAKE, SHROUD OR PACKERS ARE REQUIRED.



THIS DRAWING HAS BEEN GENERATED AND IS MAINTAINED BY A CAD SYSTEM. CHANGES SHALL ONLY BE INCORPORATED AS DIRECTED BY AN APPROVED ENGINEERING CHANGE ORDER (ECO). PAPER COPIES ARE UNCONTROLLED.

REVISIONS				
ECN	REV.	DESCRIPTION	DATE	APPROVED



SUBMITTAL DRAWING

This drawing is submitted for spatial consideration only. Do not pre-plumb to these dimensions.

UNLESS OTHERWISE SPECIFIED: DIMENSIONS ARE IN: INCHES [mm] TOLERANCES ARE:		ENGINEERED FOR: STANDARD		 CLAUDE LAVAL CORP. FRESNO, CALIFORNIA 93727 WWW.LAKOS.COM		 LAVAL UNDERGROUND SURVEYS		
FRACTIONS ± 1"	DECIMALS .XX ± .01 .XXX ± .005 .XXXX ± .0005	ANGLES ± 1/4°	APPROVALS	DATE	TITLE SUB-28, SEPARATOR, SUB 28 TURBINE, ABS/PVC			
DO NOT SCALE DRAWING			DRAWN K.F. BITTER	11/1/05				
MATERIAL ABS / PVC			ENGR -	-				
FINISH NONE			MFG -	-				
			WORK ORDER	QTY.	SIZE C	MODEL NO.	DWG NO. 125585	REV. 01
					SCALE 1:3		EST. WT. 4.6 lb	SHEET 1 OF 1

DWG. NO. 125585 SH 1 REV. 01